

# ROCLA

OUR DIFFERENCE IS CONCRETE

## Sewerage system



# SEWERAGE

The range of products that Rocla offers in terms of sewer reticulation are:

- Reinforced concrete pipes with a HDPE lining.
- Reinforced concrete pipes with a sacrificial layer.
- Reinforced concrete pipes with Xypex BIO-SAN C500 (300mm – 600mm diameter pipes)

## Reinforced concrete pipes with a HDPE lining

A HDPE lined concrete pipe offers the advantages of a conventional concrete pipe as well as a plastic pipe i.e. it maintains its shape under load and is inert to acid attack. It is an ideal product for large diameter gravity pipelines in almost any condition. Standard HDPE lining is light green and 3mm thick. Different colours and thicknesses can be supplied.


Table 1: Spigot and Socket (RJ) Pipes with HDPE Lining.

### Spigot & Socket (RJ) Pipes with HDPE lined pipes.

Notes:

- The joint uses the rolling rubber ring principal and no lubricant is required.
- Pipe class greater than 100D can be supplied. Contact Rocla for enquiries.
- For satisfactory performance the allowable joint deflections given below should not be exceeded:

Nominal diameters (mm)	300-375	450-600	675-900	1050-1200	1350-1800
Maximum deflection (°)	2	1.5	1	0.75	0.5

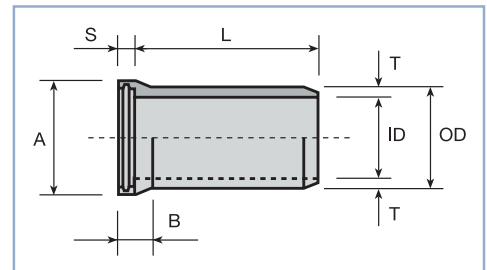


Pipe Class	Nominal Diameter	Inside Diameter	Outside Diameter	Wall Thickness	Nominal Length	Socket Outside Diameter (A)	Socket Outside Length (B)	Socket Slip (S)	Approximate Pipe Mass
	(mm)	(mm)	(mm)	(mm)	(mm)	(mm)	(mm)	(mm)	(kg)
50D	750	750	890	70	2500	1016	330	170	1293
	900	900	1041	70.5	2500	1194	360	170	1565
	1000	1000	1170	85	2500	1325	390	200	2095
	1200	1200	1390	95	2500	1543	425	205	2800
	1400	1400	1620	110	2500	1808	460	225	3804
	1500	1500	1740	120	2500	1947	490	240	4493
	1650	1640	1878	119	2500	2088	510	240	4860
75D	1800	1755	2019	132	2500	2250	525	240	5796
	750	750	890	70	2500	1016	330	170	1293
	900	900	1041	70.5	2500	1194	360	170	1565
	1000	1000	1170	85	2500	1325	390	200	2095
	1200	1200	1390	95	2500	1543	425	205	2800
	1400	1400	1620	110	2500	1808	460	225	3804
	1500	1500	1740	120	2500	1947	490	240	4493
100D	1650	1640	1878	119	2500	2088	510	240	4860
	1800	1755	2019	132	2500	2250	525	240	5796
	750	750	890	70	2500	1016	330	170	1293
	900	900	1170	70.5	2500	1194	360	170	1565
	1000	1000	1390	85	2500	1325	390	200	2095
	1200	1200	1620	95	2500	1543	425	205	2800
	1400	1400	1740	110	2500	1808	460	225	3804
	1500	1500	1878	120	2500	1947	490	240	4493
	1650	1640	946	119	2500	2088	510	240	4860
	1800	1755	2019	132	2500	2250	525	240	5796




## Joint sealing of HDPE lined pipes

The exposed concrete in the joints of the pipeline needs to be protected against the corrosive gasses. A HDPE capping strip is welded over the joint of the pipe after installation. The capping strip is as specified by the Consultant and is generally 200mm wide and the same thickness as the lining used in the pipe. The supply and installation of the capping strip is not carried out by ROCLA but by an independent contractor proficient in the process.


One 100mm long section of lining at the invert or at 60° either side of the pipe invert should not be welded so that any ground water that may gradually accumulate over time in the space behind the lining is relieved.

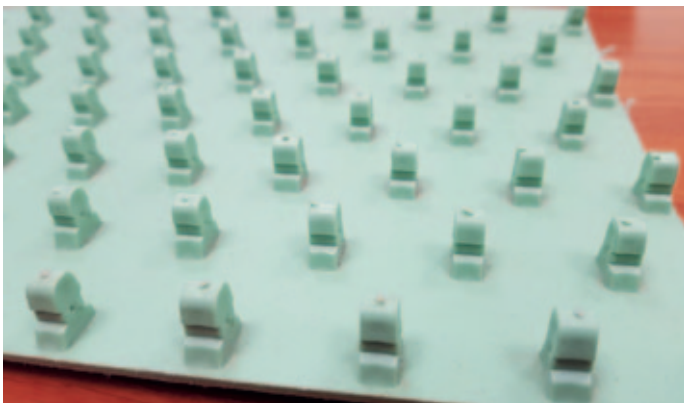

HDPE lining showing anchor knobs



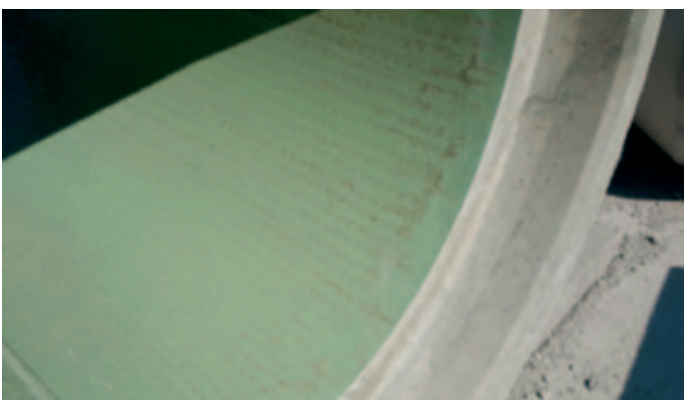


HDPE lined pipe

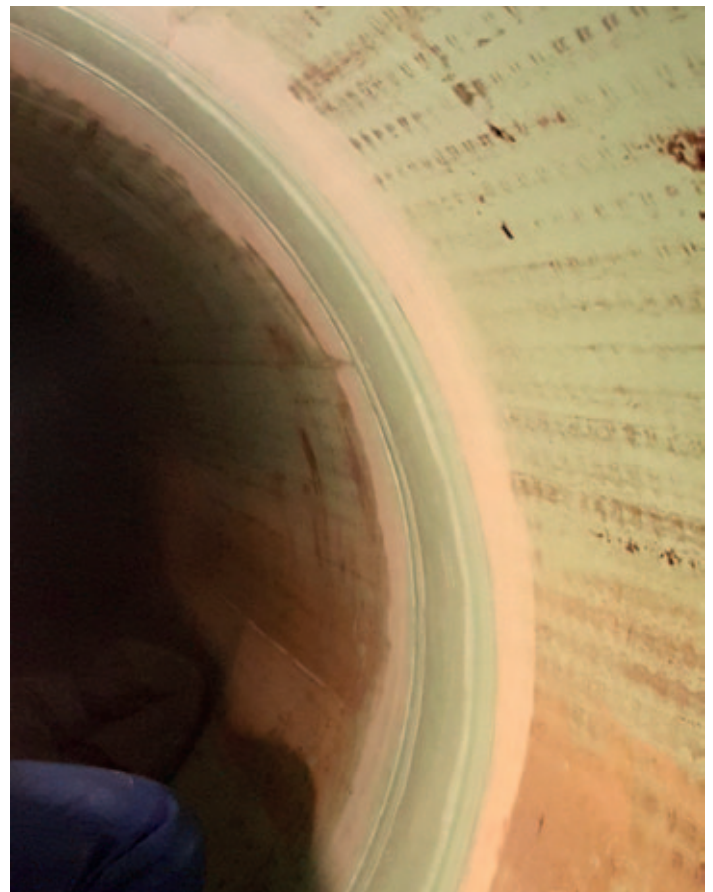

HDPE lining with installed capping strip

# Details of joint sealing of HDPE lined pipes

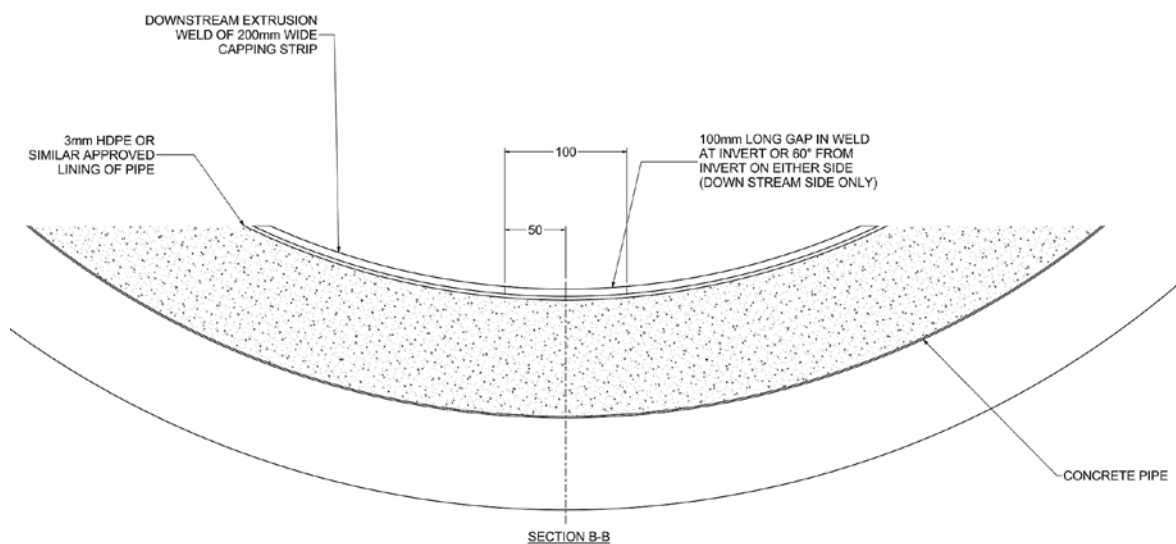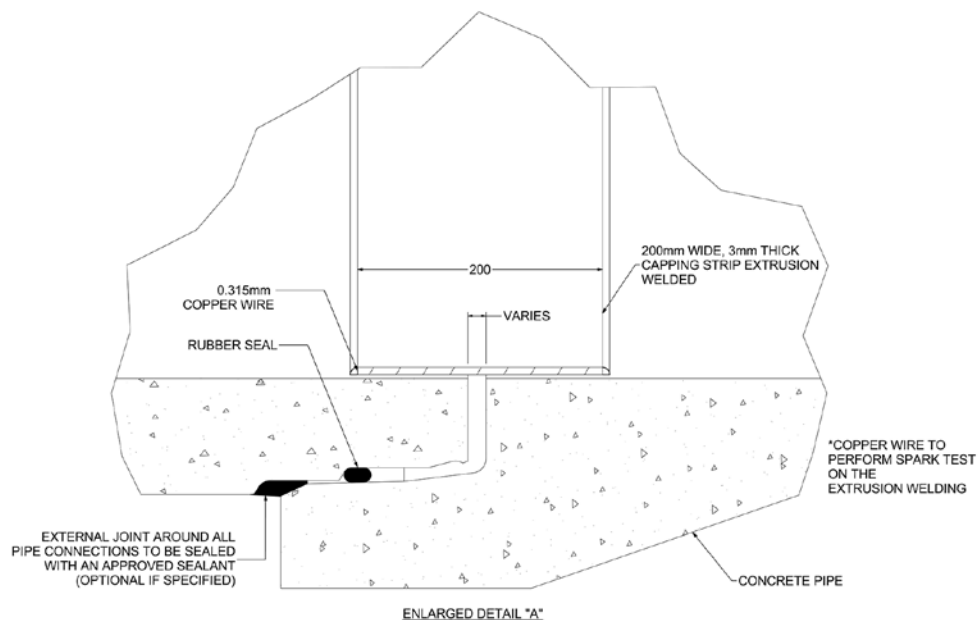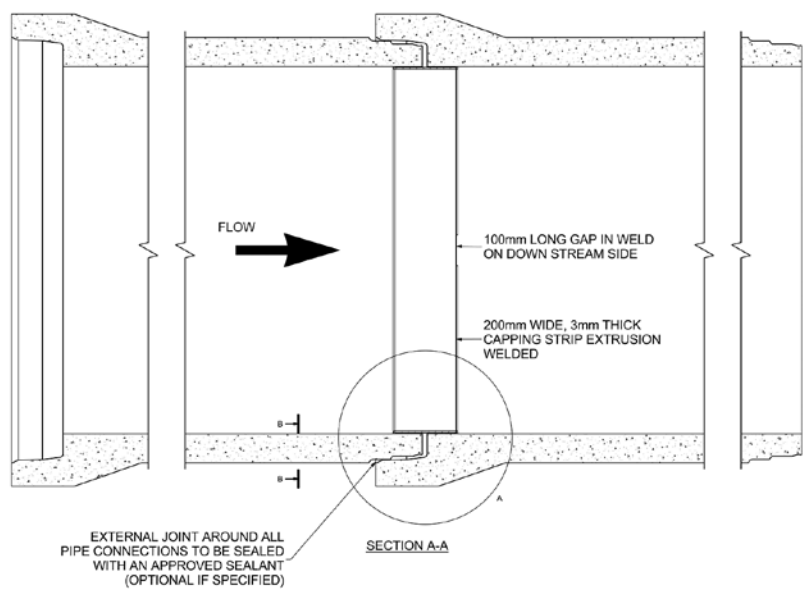




## Accessories

### Pipes with access hole



### Bends

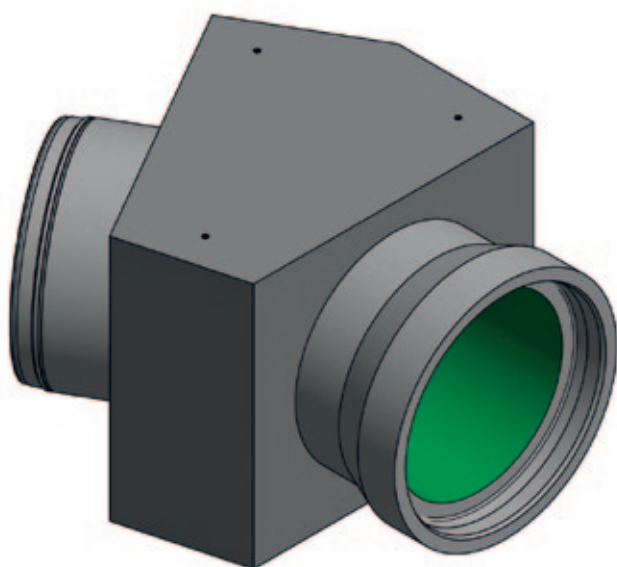

Rocla can supply custom made bends up to 30°

# Reinforced concrete pipes with a sacrificial layer

Rocla offers the following sacrificial layer pipes:

## Host pipe:

- Dolomitic aggregate and ordinary Portland cement
- Siliceous aggregate and ordinary Portland cement

## Sacrificial layer:

- Dolomitic aggregate and ordinary Portland cement
- Dolomitic aggregate and calcium aluminate cement

It is recommended that the joints of sacrificial layer pipeline are sealed (refer to “Joint Sealing”).

## Joint sealing of sacrificial layer pipes

The exposed concrete in the joints of the pipeline needs to be protected against the corrosive gasses. The inside of the joint consists of Portland cement and Siliceous aggregates which will not give the same resistance to sewer corrosion as the sacrificial layer in the barrel of the pipe.

Rocla, as suppliers of concrete pipes, cannot be prescriptive as to the sealing material that should be used. That remains the prerogative and responsibility of the Consultant. The following recommendations can however be made:

### Sealing of man-entry pipes:

The sealing of man-entry pipes normally consists of a Polyurethane Sealant plus a Backing

- Compriband allows larger movement in joints
- Nitoseal PU (a multi-component joint sealant based on polyurethane technology) and Epidermix 326 as a primer may be specified.
- Polysulphide does not work well under wet conditions
- Modified bitumen and rubber with a primer only accommodates small movements
- Bitujoint putty with a Bituprime only accommodates small movements. The sealant may drop out of large diameter pipe joints unless great care is taken

### Sealing of non man-entry pipes:

The sealing of non man-entry pipes is done during the jointing of the pipes. The recommended materials to be used are Bitujoint Putty and a Bituprime as supplied by ABE Industrial Products (Pty) Ltd. Before the pipes are jointed, the end face of the spigot is to be covered with a layer of Bitujoint Putty. The putty will then extrude out of the joint when the pipes are forced home. Excess putty is to be trimmed to the pipes internal bore.



Pipes with Sacrificial Layer

Table 2: Spigot and Socket (R) Pipes with sacrificial layer.

**Spigot & Socket (R) pipes with sacrificial layer.****Notes:**


1. The joint uses the rolling rubber ring principal and no lubricant is required.
2. Pipe class greater than 100D can be supplied. Contact Rocla for enquiries.
3. For satisfactory performance the allowable joint deflections given below should not be exceeded:

Nominal diameters (mm)	300-375	450-600	675-900	1050-1200	1350-1800
Maximum deflection (°)	2	1.5	1	0.75	0.5

4. Standard sacrificial layer thickness is as follows:

Nominal diameters (mm)	300-1050	1200-1800
Sacrificial layer thickness (mm)	13	19

5. Pipes with different sacrificial layer thicknesses can be supplied. Contact Rocla for enquiries.

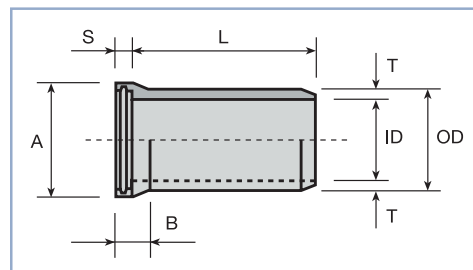

Pipe Class	Nominal Diameter	Inside Diameter	Outside Diameter	Wall Thickness	Nominal Length	Socket Outside Diameter (A)	Socket Outside Length (B)	Socket Slip (S)	Approximate Pipe Mass
	(mm)	(mm)	(mm)	(mm)	(mm)	(mm)	(mm)	(mm)	(kg)
50D	300	272	368	48	2440	464	225	130	331
	375	343	445	51	2440	540	235	140	431
	450	419	533	57	2440	641	260	145	587
	525	502	616	57	2440	730	265	140	691
	600	585	699	57	2440	825	300	165	811
	675	659	787	64	2440	920	315	165	1022
	750	736	870	67	2440	1016	330	170	1200
	825	804	946	71	2440	1086	330	170	1369
	900	887	1041	77	2440	1194	360	170	1647
	1050	1008	1194	93	2440	1353	390	200	2260
	1200	1149	1365	108	2440	1543	425	205	3007
	1350	1290	1524	117	2440	1708	445	215	3643
	1500	1423	1689	133	2440	1886	490	240	4601
75D	1650	1602	1878	138	2440	2088	510	240	5367
	1800	1717	2019	151	2440	2250	525	240	6327
	300	272	368	48	2440	464	225	130	331
	375	343	445	51	2440	540	235	140	431
	450	419	533	57	2440	641	260	145	587
	525	488	616	64	2440	730	265	140	760
	600	559	699	70	2440	825	300	165	958
	675	633	787	77	2440	920	315	165	1188
	750	704	870	83	2440	1016	330	170	1428
	825	762	946	92	2440	1086	330	170	1694
	900	843	1041	99	2440	1194	360	170	2023
	1050	960	1194	117	2440	1353	390	200	2727
	1200	1119	1365	123	2440	1543	425	205	3344
100D	1350	1254	1524	135	2440	1708	445	215	4095
	1500	1381	1689	154	2440	1886	490	240	5183
	1650	1562	1878	158	2440	2088	510	240	5993
	1800	1669	2019	175	2440	2250	525	240	7131
	300	272	368	48	2440	464	225	130	331
	375	343	445	51	2440	540	235	140	431
	450	419	533	57	2440	641	260	145	587
	525	488	616	64	2440	730	265	140	760
	600	559	699	70	2440	825	300	165	958
	675	633	787	77	2440	920	315	165	1188
	750	704	870	83	2440	1016	330	170	1428
	825	762	946	92	2440	1086	330	170	1694
	900	843	1041	99	2440	1194	360	170	2023
	1050	960	1194	117	2440	1353	390	200	2727
	1200	1089	1365	138	2440	1543	425	205	3671
	1350	1224	1524	150	2440	1708	445	215	4463
	1500	1345	1689	172	2440	1886	490	240	5668
	1650	1510	1878	184	2440	2088	510	240	6783
	1800	1627	2019	196	2440	2250	525	240	7815

## Reinforced concrete pipes with Xypex BIO-SAN C500

Concrete pipes with Xypex BIO-SAN C500 are offered for 300mm to 600mm diameter pipes. Xypex Bio-San C500 is a uniquely designed admixture for integral, long-term protection of concrete in harsh sewage conditions with high levels of H<sub>2</sub>S that cause microbial induced corrosion in pipelines. The protection is for the full wall of the pipe and hence no extra joint sealing is required. For more details visit [www.msasa.co.za](http://www.msasa.co.za)


Table 3: Spigot and Socket (RJ) Pipes with BIO-SAN admixture

### Spigot & Socket (RJ) pipes with BIO-SAN C500


Notes:

1. The joint uses the rolling rubber ring principal and no lubricant is required.
2. Pipe class greater than 100D can be supplied. Contact Rocla for enquiries.
3. For satisfactory performance the allowable joint deflections given below should not be exceeded:

Nominal diameters (mm)	300-375	450-600	675-900	1050-1200	1350-1800
Maximum deflection (°)	2	1.5	1	0.75	0.5

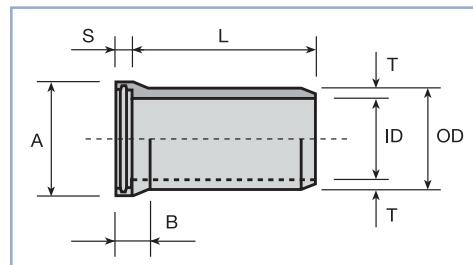

Pipe Class	Nominal Diameter	Inside Diameter	Outside Diameter	Wall Thickness	Nominal Length	Socket Outside Diameter (A)	Socket Outside Length (B)	Socket Slip (S)	Approximate Pipe Mass
	(mm)	(mm)	(mm)	(mm)	(mm)	(mm)	(mm)	(mm)	(kg)
50D	300	298	368	35	2440	464	225	130	258
	375	369	445	38	2440	540	235	140	340
	450	455	533	44	2440	641	260	145	476
	525	528	616	44	2440	730	265	140	559
	600	611	699	44	2440	825	300	165	658
75D	300	298	368	35	2440	464	225	130	258
	375	369	455	38	2440	540	235	140	340
	450	445	533	44	2440	641	260	145	476
	525	514	616	51	2440	730	265	140	631
	600	585	699	57	2440	825	300	165	811
100D	300	298	368	35	2440	464	225	130	258
	375	369	455	38	2440	540	235	140	340
	450	455	533	44	2440	641	260	145	476
	525	514	616	51	2440	730	265	140	631
	600	585	699	57	2440	825	300	165	811

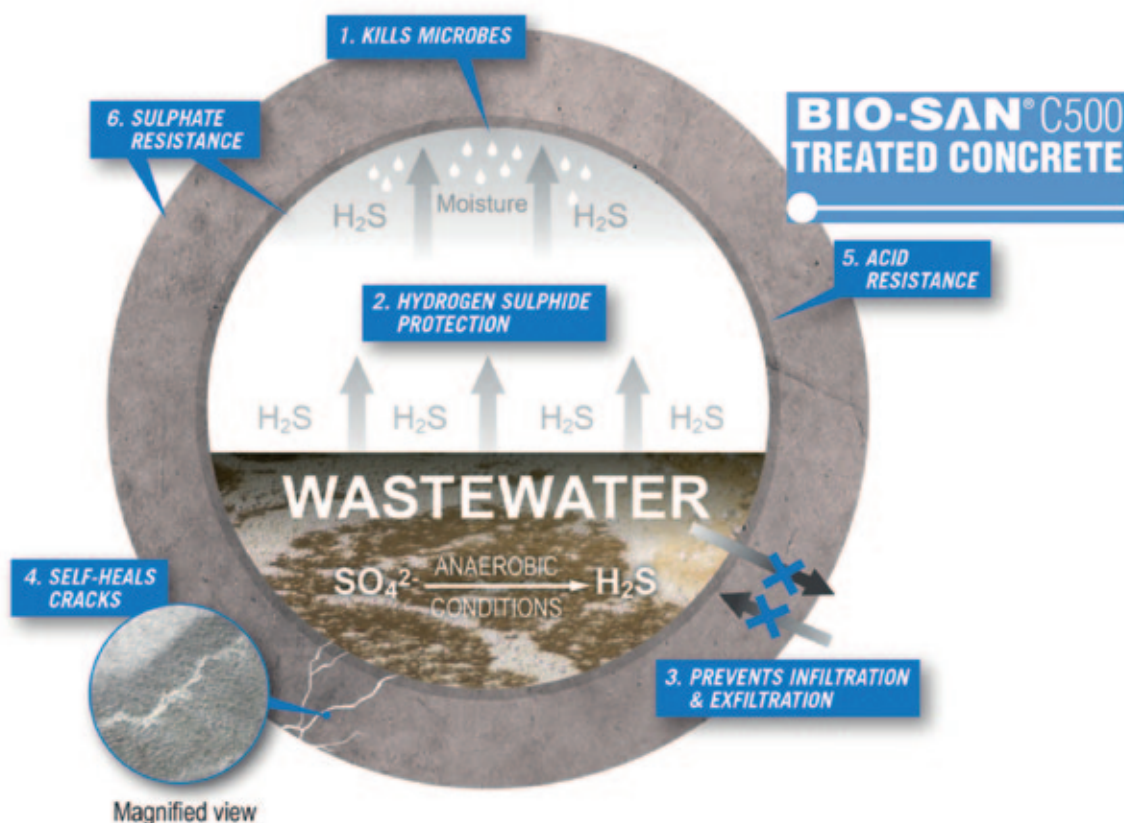



# MANHOLES

Manholes form an integral part of sewer reticulation systems through providing access for inspection and maintenance purposes. Manholes are also used to facilitate changes in the direction of effluent flow as required.

Rocla manufactures various manhole components to accommodate a wide range of project specifications. Standard manhole components for sewers are manufactured with OPC cement and dolomitic aggregates.

HDPE lined manhole components are also manufactured. This gives total protection against corrosive gases that are formed in the sewer system. All joints between the manhole components are protected by a capping strip that is welded over the joints after installation. The supply and installation of the capping strip is not carried out by ROCLA but by an independent contractor proficient in the process.

## HDPE Lined manhole components

**Manhole Chambers with HDPE Lining**

Normal Diameter	Inside Diameter	Outside Diameter	Wall Thickness	Nominal Length	Approx Mass	Proof Load
ND	ID	OD	T	L		
mm	mm	mm	mm	mm	kg/unit	kN/m
1250	1250	1400	75	250	201	15
	1250	1400	75	1000	805	15
1500	1500	1690	95	500	614	15
	1500	1690	95	1000	1228	15
1800	1800	2020	110	500	851	15
	1800	2020	110	1000	1703	15

**Reducer Slabs**





Reducer Slab	Reduce To	Thickness mm	Approx Mass kg
1000	750	150	217
1250	750	150	425
1500	750	175	812
1800	750	175	1246
1950	750	195	1662

**Cover Slabs**

Cover Slab	Reduce To	Thickness mm	Approx Mass kg
1000	560	150	279
1250	560	150	486
1500	560	175	884
1800	560	175	1318
1950	560	195	1742



# HDPE Lined Manhole Assembly

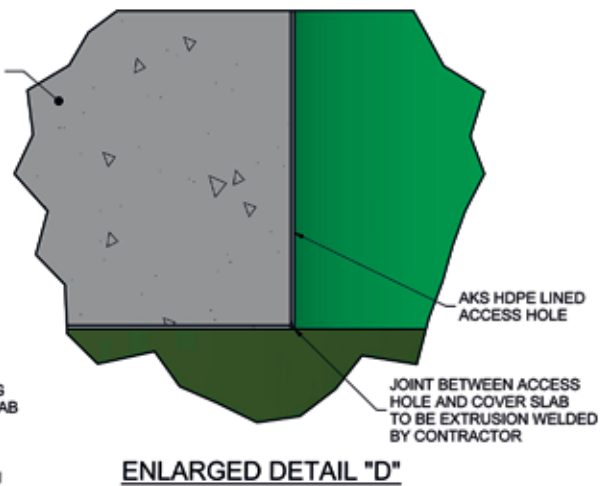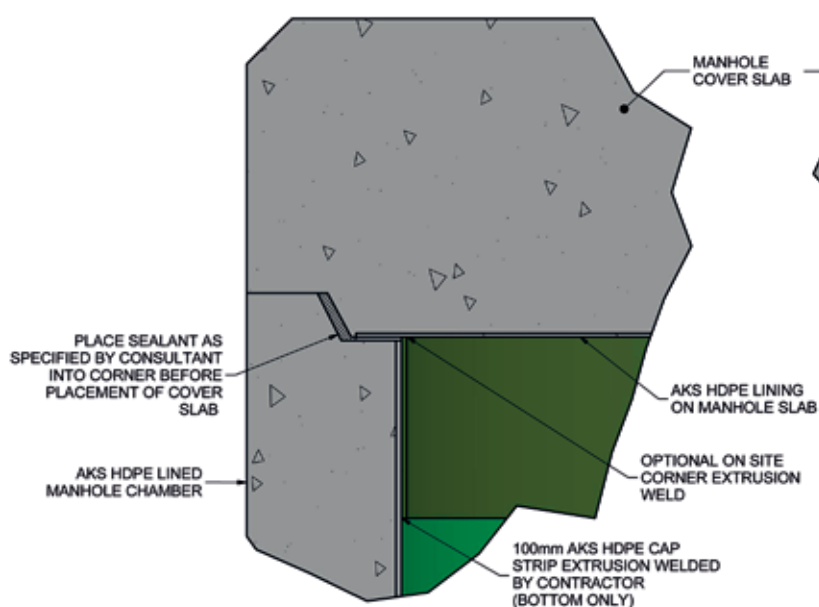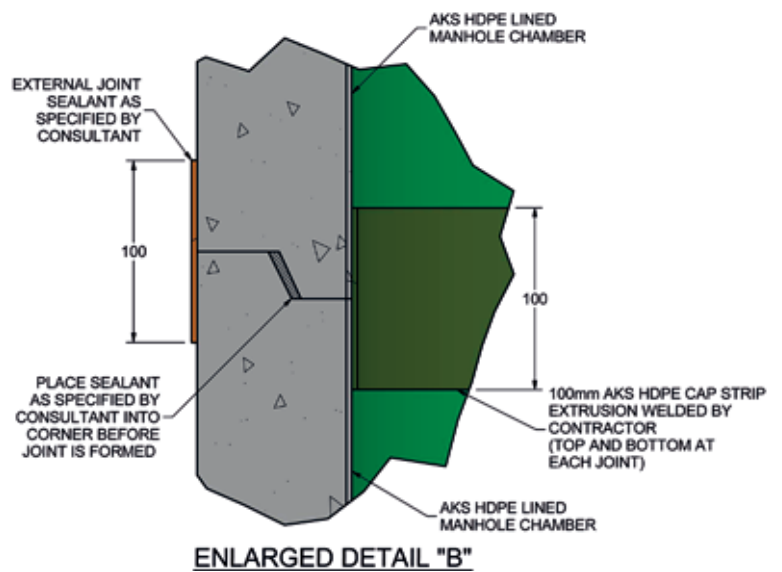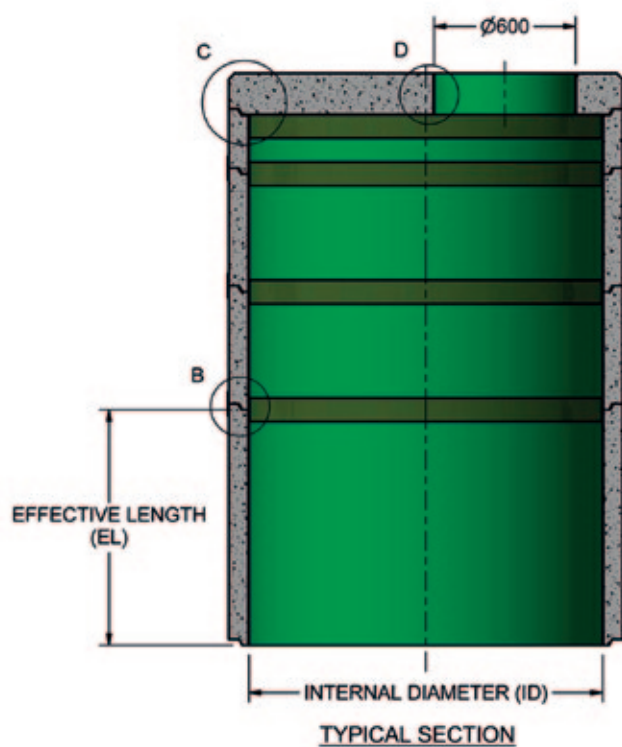

## General: Spigot and socket pipes

### Specification

- 1) Sewer pipes fall into the SI category as defined by SANS 677 and should be specified as such.
- 2) Specification of sewer pipes must be done in accordance with SANS 677 and should include:
  - a. Nominal diameter
  - b. Application class
  - c. Strength class
  - d. Joint Type
  - e. Additional corrosion protection  
(e.g. 600mm diameter type SI pipe 75D RJ with 3mm HDPE lining, or 450mm diameter type SI pipe 100D RJ with 13mm CAC sacrificial layer)

### Product specific definitions

- SC - Stormwater Culvert Pipes
- SI - Sewer & Irrigation Pipes
- RJ - Spigot and socket pipe with a Rolling rubber ring Joint
- ND - Nominal Diameter
- L - Effective Length
- ID - Inside Diameter
- OD - Outside Diameter
- CMA - Concrete Manufacturers Association
- CPA - Concrete Pipe Association
- CAC - Calcium Aluminate Cement
- OPC - Ordinary Portland Cement
- Host Pipe - The standard precast pipe that provides structural strength to a pipe in which a sacrificial layer is cast
- Sacrificial Layer- Additional concrete layer on the inside of a host pipe, which provides protection against corrosion
- HDPE Liner - High Density Polyethylene lining. The product takes on the form of AKS (as defined below)
- AKS - Anchor Knob Sheet (HDPE)

### Design and construction guidelines

SANS 677 – Concrete non pressure pipes	SABS
SANS 10102 (Parts I and II) – The selection of pipes for buried pipelines	SABS
Concrete Pipe & Portal Culvert Handbook	CMA
Design Manual for Concrete Pipe Outfall Sewers	CMA
Concrete Pipe & Portal Culvert Installation Manual	CMA
Fill Heights Over Concrete Pipes	CMA
Rigid vs. Flexible Pipes	CPA
SANS 2001 – Concrete works	SABS



## ROCLA NATIONWIDE

Positioned to serve your needs, Rocla's 11 factories are strategically located throughout South Africa's nine provinces and in Namibia and Botswana.

South Africa and offshore markets are cost effectively supplied by road, rail and sea.

Made by modern processes, supervised in accordance with the ISO 9001 Quality Management System, Rocla's factories make products that proudly carry the CMACS Mark of Approval.

- **Head Office, Roodepoort:** Tel: (011) 670-7600, Fax: (086) 677-1510
- **Blackheath:** Tel: (021) 905-1270, Fax: (021) 905-2913
- **De Aar:** Tel (053) 631-3601/2, Fax: (053) 631-3351
- **Newcastle:** Tel: (034) 375-7848/9, Fax: (034) 375-6941
- **Nelspruit:** Tel: (087) 354-9202, Fax: (086) 681-1052
- **Polokwane:** Tel: (015) 293-1857/8, Fax: (015) 293-2821
- **Port Elizabeth:** Tel: (041) 486-1462, Fax: (041) 486-2835
- **Roodepoort:** Tel: (011) 670-7600, Fax: (086) 677-1510
- **Virginia:** Tel: (087) 354-8688, Fax: (086) 646-6291
- **Stilfontein Depot:** Tel: (010) 005-1703, Fax: (086) 685-1148
- **Windhoek, Rocla Pipes:** Tel: (002646) 126-3128, Fax: (002646) 121-5149
- **Gaborone, Kwena Rocla:** Tel: (00267) 390-4032, Fax: (00267) 390-7160

**Email:** [info@rocla.co.za](mailto:info@rocla.co.za)

**Web:** [www.rocla.co.za](http://www.rocla.co.za)



**CMACS  
APPROVED**

**ROCLA**  
OUR DIFFERENCE IS CONCRETE

**iSG**  
Infrastructure Specialist Group